


NOTES:

1. SEE DISTRICT DETAILS IRR-2 FOR POINT OF CONNECTION (P.O.C.) INFORMATION AND IRR-5 FOR BACKFLOW PREVENTION DEVICE INFORMATION.
2. ATTACH APPROPRIATE IDENTIFICATION TAPES, LABELS AND TAGS AS DIRECTED BY MNWD.
3. USE SCH 40 BRASS PIPING AND FITTINGS UP TO THE INLET SIDE OF BACKFLOW ASSEMBLIES. SEE DETAILS IRR-2, IRR-3 AND IRR-4 FOR INSTALLATION REQUIREMENTS.
4. IDENTIFY ALL PIPING AS DIRECTED BY THE DISTRICT.



LEGEND

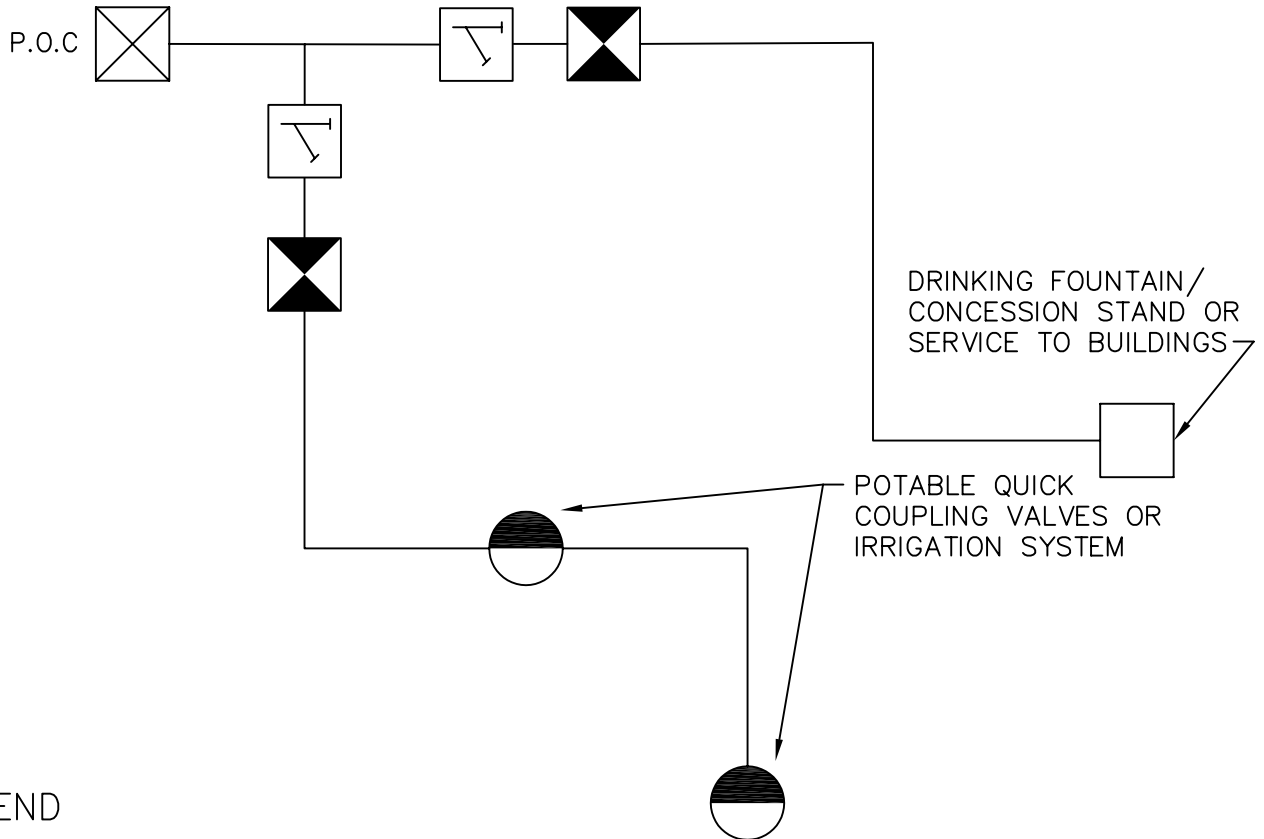

P.O.C./ WATER METER



MNWD APPROVED RPP BACKFLOW ASSEMBLY



QUICK COUPLING VALVE (USE PIN TYPE QUICK COUPLING VALVES ON POTABLE WATER IRRIGATION SYSTEMS)



STRAINER

MOULTON NIGUEL WATER DISTRICT	IRR-6
BACKFLOW PREVENTION LAYOUT	