


NOTES:

1. ATTACH PURPLE RECYCLED IDENTIFICATION TAGS AS DIRECTED ON RECYCLED SYSTEM.
2. ATTACH BLUE POTABLE WATER IDENTIFICATION TAGS AS DIRECTED ON POTABLE SYSTEMS.
3. ATTACH GREEN POTABLE WATER IDENTIFICATION TAGS AS DIRECTED ON POTABLE IRRIGATION SYSTEMS.
4. VALVES UP TO 3 INCHES DIA. SHALL HAVE MALLABLE IRON TEE HANDLES, VALVES LARGER THAN 3 INCHES SHALL HAVE SQUARE OPERATING NUTS.
5. 4-45°SCH 80 PVC ELBOW FITTINGS SHALL BE USED TO RAISE BALL/GATE VALVE TO WITHIN 12" OF FINISH GRADE.
6. USE PURPLE RECYCLED WATER IDENTIFICATION VALVE BOXES AND COVER FOR RECYCLED WATER SYSTEMS.
7. IDENTIFY RECYCLED WATER PIPING BY ATTACHING 3" WIDE PURPLE IDENTIFICATION TAPE (SEE DETAIL IRR-26).
8. IDENTIFY POTABLE WATER PIPING USED FOR IRRIGATION BY ATTACHING 3" WIDE GREEN IDENTIFICATION TAPE (SEE DETAIL IRR-26).
9. IDENTIFY POTABLE WATER PIPING BY ATTACHING 3" WIDE BLUE IDENTIFICATION TAPE (SEE DETAIL IRR-26).
10. FOR SCH 40 GALVANIZED PIPING CONTACT MNWD.

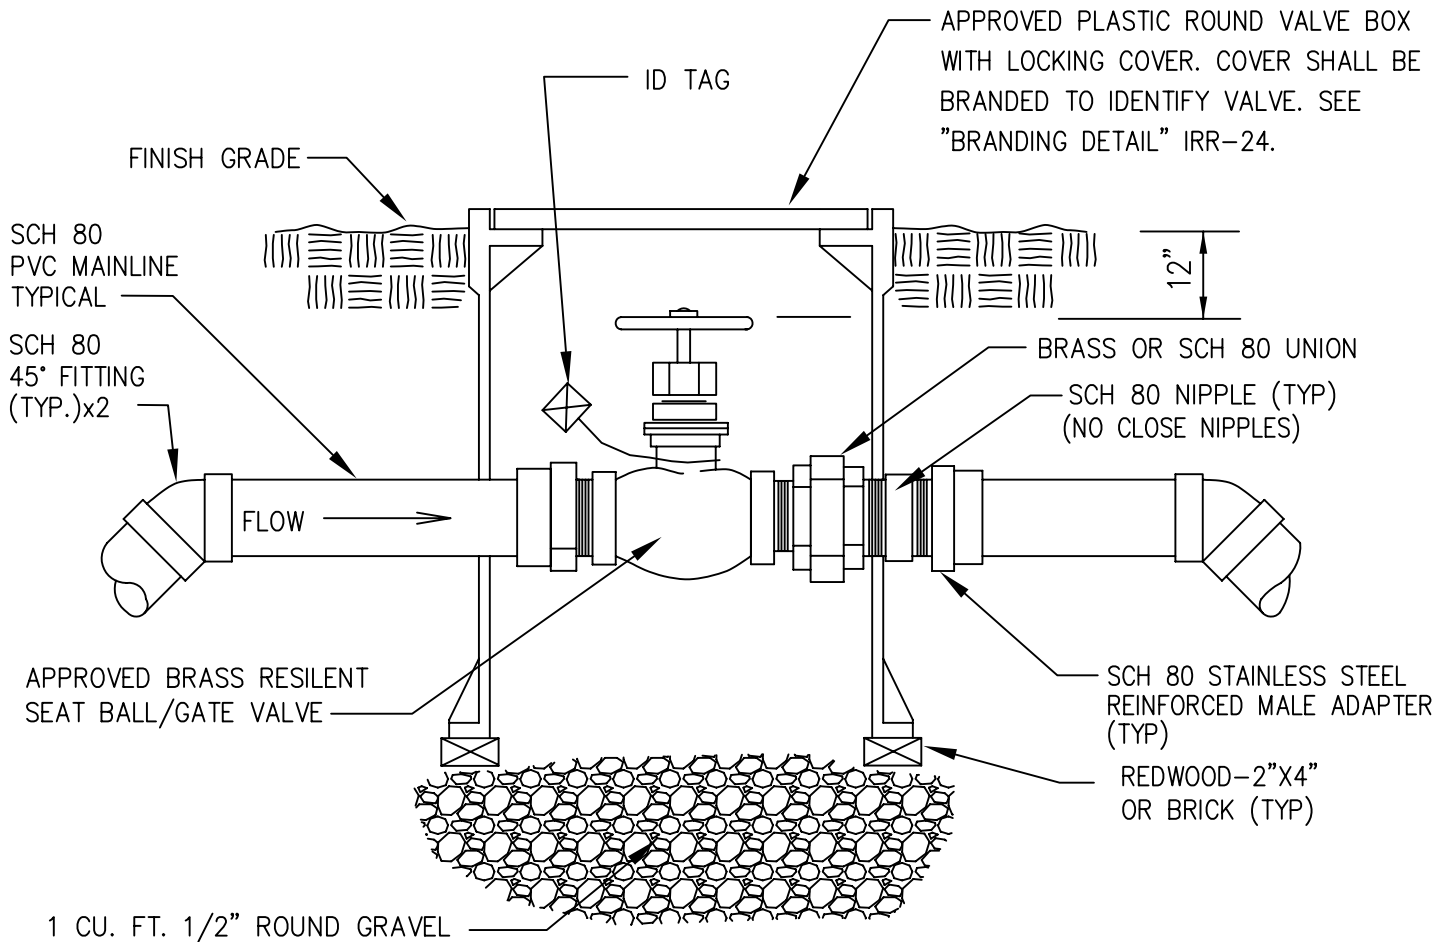

MOULTON NIGUEL WATER DISTRICT	IRR-11
BALL/GATE VALVE	