



BEFORE RETROFIT

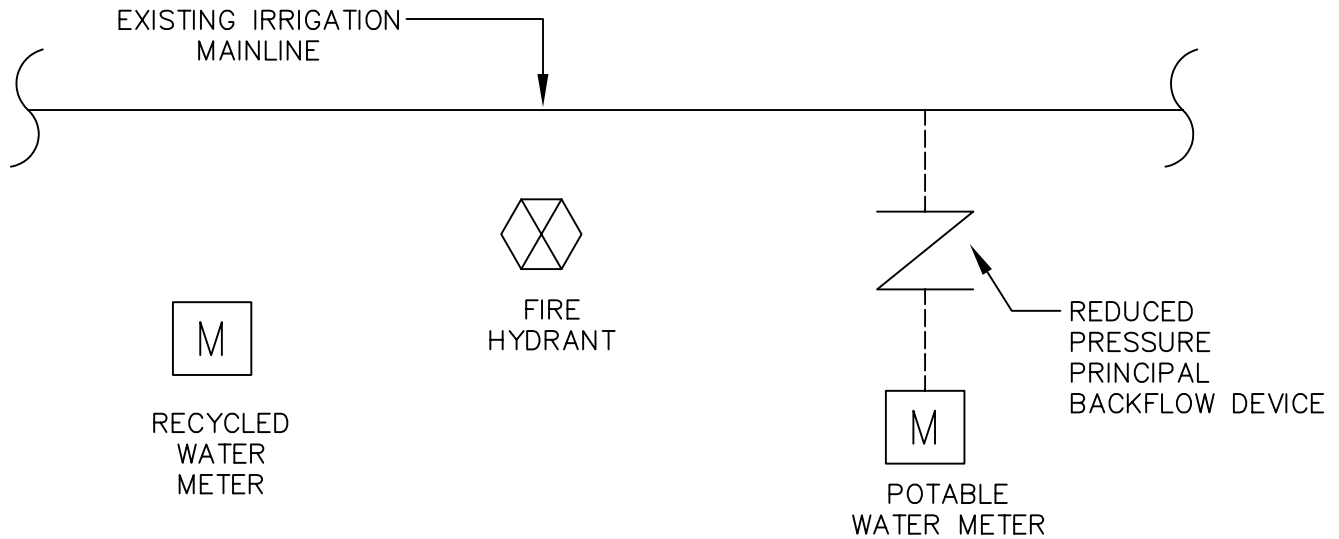

AFTER RETROFIT

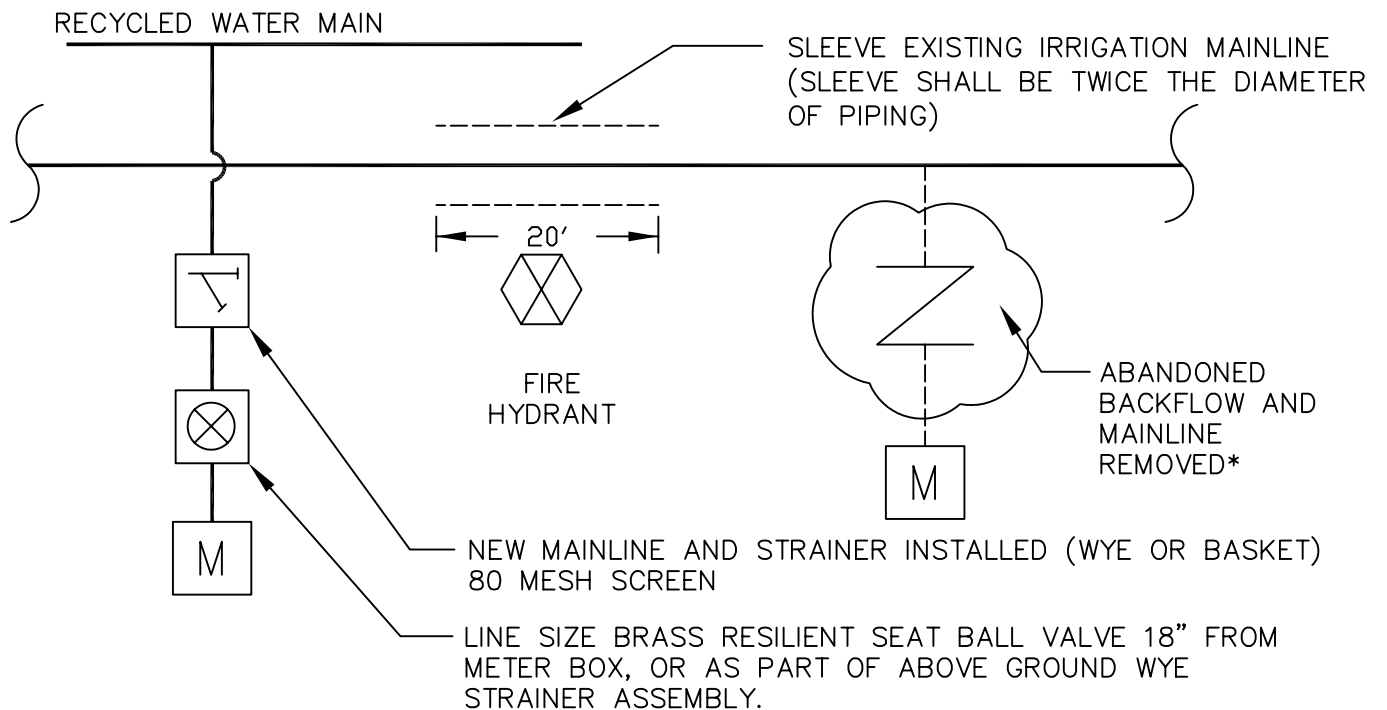

NOTES:

1. SEE SLEEVING REQUIREMENTS (PROVISION 6) FOR DETAILS.
2. BACKFLOW AND MAINLINE ABANDONED BY OWNER, AND P.O.C. ABANDONED BY DISTRICT*.
3. PRESSURE REGULATORS ARE REQUIRED IF POINT OF CONNECTION STATIC PRESSURE IS 50 PSI OR GREATER.
4. SEE SLEEVING FOR RECYCLED SYSTEMS CROSSING POTABLE SYSTEMS (IRR-13).

MOULTON NIGUEL WATER DISTRICT	IRR-31
RECYCLED WATER RETROFIT POINT OF CONNECTION REQUIREMENTS	